
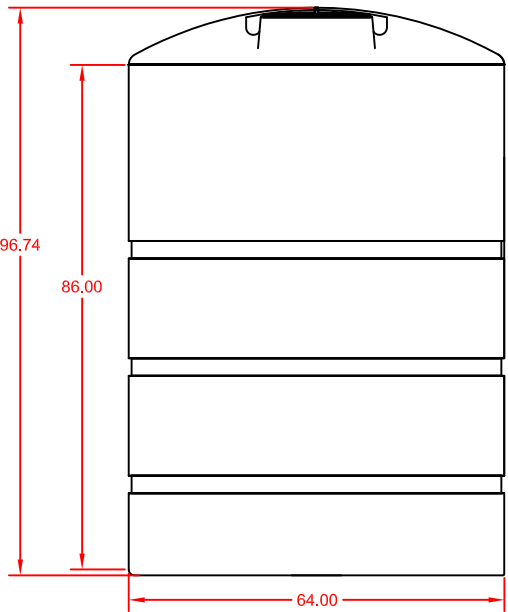


| NOZZLE SCHEDULE & ACCESSORY LIST |     |      |                     |     |      |
|----------------------------------|-----|------|---------------------|-----|------|
| TAG                              | QTY | SIZE | DESCRIPTION         | DEG | ELEV |
| A                                | 1   | 16   | THREADED TOP ACCESS |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |
|                                  |     |      |                     |     |      |

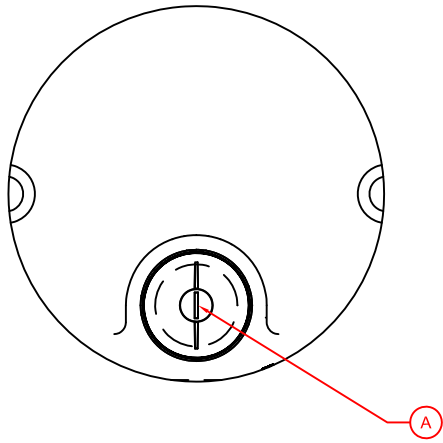


GENERAL NOTES:

- MATERIAL: TANK TO BE ONE PIECE MOLDED OF HIGH DENSITY POLYETHYLENE, COLOR: NATURAL, DESIGNED FOR CONTENTS TO 1.7 S.G. PER ASTM D1998-06 FOR TYPE II TANKS USING A 600 PSI HOOP
- CONTENTS: WATER
- OPERATING TEMP: 73° F
- FLANGES TO BE HAND WELDED W/ NITROGEN GAS
- ORIENT ALL FITTINGS FROM PLAN VIEW
- TANK REQUIRES 100% BOTTOM SUPPORT
- ALL PIPING & VALVES MUST HAVE IT'S OWN SUPPORT AND ALLOW FOR TANK EXPANSION & CONTRACTION OF 1.5% DIMENSIONAL MOVEMENT. FLEX CONNECTIONS SHOULD BE DESIGNED FOR A .5° ANGULAR MOVEMENT.
- TANK IS TO BE LOCATED INDOORS
- TANK IS DESIGNED FOR ATMOSPHERIC PRESSURE ONLY
- ALL WFN/WPFN FLANGES ARE 150# BOLT SPACED PER ANSI B16.5, THEY ARE FULL RAISED FACE DESIGN AND REQUIRE FULL FACED GASKETS.
- ALL WFN/WPFN NOZZLES REQUIRE 11 FT-LBS OF TORQUE TO SEAL. DO NOT OVER TIGHTEN FLANGES.
- CHECK BOLT LENGTH WHEN PIPING TO A WPFN FLANGE BEFORE INSTALLATION. WPFN REQUIRE SHORTER BOLT LENGTHS.
- CHECK ALL CHEMICAL AND TEMPERATURE COMPATIBILITY WITH CONSTRUCTION MATERIAL PRIOR TO TANK USE. PROTECTOPLAS DOES NOT WARRANT FOR CHEMICAL ATTACK OR PRODUCT MISUSE.
- ALL DIM. ARE IN INCHES/DEGREES UNLESS OTHERWISE NOTED.
- TOTAL VOLUME IS AN APPROX. FIGURE BASE ON BRIMFUL CAPACITY USING OUTER DIMENSIONS.

QUAN. REQ.: (1)

THIS DRAWING, THE NAME "PROTECTOPLAS", AND ALL LOGOS ARE PROPERTY OF EBCO INC. THEY MAY NOT BE ALTERED, COPIED, OR USED IN ANY WAY WITHOUT WRITTEN PERMISSION FROM EBCO INC.

|  |                         |                                     |
|--|-------------------------|-------------------------------------|
|  |                         |                                     |
| REV. NO.   | REV. BY                 | REV. NOTE                           |
| CUSTOMER   |                         |                                     |
| TITLE  | VT1200-64 VERTICAL TANK |                                     |
|  <b>PROTECTOPLAS COMPANY</b><br>DIVISION OF EBCO, INC.<br>STREETSBORO, OHIO 44241 USA |                         |                                     |
| SCALE: NTS   | BY: ZE                  | DATE: 10/9/2015   DRW NO. VT1200-64 |